

## 2002 Home with swimming pool



**January 30, 2019**

Elite Inspection Group

P.O. Box 2205

Frisco, TX 75034

469-818-5500

## Property Inspection Report

Prepared For: Smart Home Buyer

Concerning: 2002 Home with swimming pool

By: Darrell Murphy –TREC #22992 – 318-218-9518

Date: 1/30/2019

---

### PURPOSE, LIMITATIONS AND INSPECTOR / CLIENT RESPONSIBILITIES

This property inspection report may include an inspection agreement (contract), addenda, and other information related to property conditions. If any item or comment is unclear, you should ask the inspector to clarify the findings. It is important that you carefully read ALL of this information.

This inspection is subject to the rules ("Rules") of the Texas Real Estate Commission ("TREC"), which can be found at [www.trec.texas.gov](http://www.trec.texas.gov)

The TREC Standards of Practice (Sections 535.227-535.233 of the Rules) are the minimum standards for inspections by TREC-licensed inspectors. An inspection addresses only those components and conditions that are present, visible, and accessible at the time of the inspection. While there may be other parts, components or systems present, only those items specifically noted as being inspected were inspected. The inspector is NOT required to turn on decommissioned equipment, systems, and utility services or apply an open flame or light a pilot to operate any appliance. The inspector is NOT required to climb over obstacles, move furnishings or stored items. The inspection report may address issues that are code-based or may refer to a particular code; however **THIS IS NOT A CODE COMPLIANCE INSPECTION** and does NOT verify compliance with manufacturer's installation instructions. **THE INSPECTION DOES NOT IMPLY INSURABILITY OR WARRANTABILITY OF THE STRUCTURE OR ITS COMPONENTS.** Although some safety issues may be addressed in this report, **THIS REPORT IS NOT A SAFETY/CODE INSPECTION**, and the inspector is NOT required to identify all potential hazards.

In this report, the inspector shall indicate, by checking the appropriate boxes on the form, whether each item was inspected, not inspected, not present or deficient and explain the findings in the corresponding section in the body of the report form. The inspector must check the Deficient (D) box if a condition exists that adversely and materially affects the performance of a system or component or constitutes a hazard to life, limb or property as specified by the TREC Standards of Practice. General deficiencies include inoperability, material distress, water penetration, damage, deterioration, missing components, and unsuitable installation. Comments may be provided by the inspector whether or not an item is deemed deficient. The inspector is not required to prioritize or emphasize the importance of one deficiency over another.

Some items reported may be considered life-safety upgrades to the property. For more information, refer to Texas Real Estate Consumer Notice Concerning Recognized Hazards or Deficiencies below.

THIS PROPERTY INSPECTION IS NOT A TECHNICALLY EXHAUSTIVE INSPECTION OF THE STRUCTURE, SYSTEMS OR COMPONENTS. **THE INSPECTION MAY NOT REVEAL ALL DEFICIENCIES. A REAL ESTATE INSPECTION HELPS TO REDUCE SOME OF THE RISK INVOLVED IN PURCHASING A HOME, BUT IT CANNOT ELIMINATE THESE RISKS, NOR CAN THE INSPECTION ANTICIPATE FUTURE EVENTS OR CHANGES IN PERFORMANCE DUE TO CHANGES IN USE OR OCCUPANCY.** It is recommended that you obtain as much information as is available about this property, including any seller's disclosures, previous inspection reports, engineering reports, building/remodeling permits, and reports performed for or by relocation companies, municipal inspection departments, lenders, insurers, and appraisers. You should also attempt to determine whether repairs, renovation, remodeling, additions, or other such activities have taken place at this property.

It is not the inspector's responsibility to confirm that information obtained from these sources is complete or accurate or that this inspection is consistent with the opinions expressed in previous or future reports.

**ITEMS IDENTIFIED IN THE REPORT DO NOT OBLIGATE ANY PARTY TO MAKE REPAIRS OR TAKE OTHER ACTIONS, NOR IS THE PURCHASER REQUIRED TO REQUEST THAT THE SELLER TAKE ANY ACTION.** *When a deficiency is reported, it is the client's responsibility to obtain further evaluations and/or cost estimates from qualified service professionals. Any such follow-up should take place prior to the expiration of any time limitations such as option periods. Evaluations by qualified tradesmen may lead to the discovery of additional deficiencies which may involve additional repair costs.* Failure to address deficiencies or comments noted in this report may lead to further damage of the structure or systems and add to the original repair costs. The inspector is not required to provide follow-up services to verify that proper repairs have been made.

Property conditions change with time and use. For example, mechanical devices can fail at any time, plumbing gaskets and seals may crack if the appliance or plumbing fixture is not used often, roof leaks can occur at any time regardless of the apparent condition of the roof, and the performance of the structure and the systems may change due to changes in use or occupancy, effects of weather, etc. These changes or repairs made to the structure after the inspection may render information contained herein obsolete or invalid. ***This report is provided for the specific benefit of the client named above and is based on observations at the time of the inspection. If you did not hire the inspector yourself, reliance on this report may provide incomplete or outdated information.*** Repairs, professional opinions or additional inspection reports may affect the meaning of the information in this report. It is recommended that you hire a licensed inspector to perform an inspection to meet your specific needs and to provide you with current information concerning this property.

### TEXAS REAL ESTATE CONSUMER NOTICE CONCERNING HAZARDS OR DEFICIENCIES

Each year, Texans sustain property damage and are injured by accidents in the home. While some accidents may not be avoidable, many other accidents, injuries, and deaths may be avoided through the identification and repair of certain hazardous conditions. Examples of such hazards include:

- malfunctioning, improperly installed, or missing ground fault circuit protection (GFCI) devices for electrical receptacles in garages, bathrooms, kitchens, and exterior areas;
- malfunctioning arc fault protection (AFCI) devices;
- ordinary glass in locations where modern construction techniques call for safety glass;
- malfunctioning or lack of fire safety features such as smoke alarms, fire-rated doors in certain locations, and functional emergency escape and rescue openings in bedrooms;
- malfunctioning carbon monoxide alarms;
- excessive spacing between balusters on stairways and porches;
- improperly installed appliances;
- improperly installed or defective safety devices;
- lack of electrical bonding and grounding; and
- lack of bonding on gas piping, including corrugated stainless steel tubing (CSST).

To ensure that consumers are informed of hazards such as these, the Texas Real Estate Commission (TREC) has adopted Standards of Practice requiring licensed inspectors to report these conditions as "Deficient" when performing an inspection for a buyer or seller, if they can be reasonably determined.

These conditions may not have violated building codes or common practices at the time of the construction of the home, or they may have been "**grandfathered**" because they were present prior to the adoption of codes prohibiting such conditions. While the TREC Standards of Practice do not require inspectors to perform a code compliance inspection, TREC considers the potential for injury or property loss from the hazards addressed in the Standards of Practice to be significant enough to warrant this notice.

Contract forms developed by TREC for use by its real estate licensees also inform the buyer of the right to have the home inspected and can provide an option clause permitting the buyer to terminate the contract within a specified time. ***Neither the Standards of Practice nor the TREC contract forms require a seller to remedy conditions revealed by an inspection. The decision to correct a hazard or any deficiency identified in an inspection report is left to the parties to the contract for the sale or purchase of the home.***

INFORMATION INCLUDED UNDER "ADDITIONAL INFORMATION PROVIDED BY INSPECTOR", OR PROVIDED AS AN ATTACHMENT WITH THE STANDARD FORM, IS NOT REQUIRED BY THE COMMISSION AND MAY CONTAIN CONTRACTUAL TERMS BETWEEN THE INSPECTOR AND YOU, AS THE CLIENT. THE COMMISSION DOES NOT REGULATE CONTRACTUAL TERMS BETWEEN PARTIES. IF YOU DO NOT UNDERSTAND THE EFFECT OF ANY





## CONFUSED ABOUT ALL OF YOUR HOME SERVICE OPTIONS?



Tired of waiting on hold? Not sure the best rates in your area?

## LET US CONNECT THE DOTS FOR YOU

- |            |                 |             |                 |
|------------|-----------------|-------------|-----------------|
| ✓ Movers   | ✓ Cable         | ✓ Satellite | ✓ Painting      |
| ✓ Electric | ✓ Home Audio    | ✓ Internet  | ✓ Utilities     |
| ✓ Gas      | ✓ Home Security | ✓ Phone!    | ✓ And Much More |



360 Home Connect is a **complimentary** service dedicated to simplifying your search for quality home service providers with affordable rates all while providing an industry leading customer experience.

**360HomeConnect.com**

Inspection Time In: \_\_\_\_2:15\_\_\_\_ Time Out: \_\_\_\_5:50\_\_\_\_ Property was: ☒ Occupied ☐ Vacant  
Building Orientation (For The Purpose Of This Report, the Front Faces): \_\_\_\_S\_\_\_\_  
Weather conditions During Inspection: ☒ Sunny ☐ Raining ☐ Cloudy ☐ Snow/Ice Temp: 46  
Parties present at inspection: ☒ Client ☒ Buyer's Realtor ☐ Builder ☒ Seller ☐ None

**THIS REPORT IS NOT TRANSFERABLE FROM THE CLIENT NAMES ABOVE**

---

### **SCOPE OF INSPECTION**

These standards of practice define the minimum levels of inspection required for substantially completed residential improvements to real property up to four dwelling units. A real estate inspection is a non-technically exhaustive, limited visual survey and basic performance evaluation of the systems and components of a building using normal controls and does not require the use of specialized equipment or procedures. The purpose of the inspection is to provide the client with information regarding the general condition of the residence at the time of inspection. The inspector may provide a higher level of inspection performance than required by these standards of practice and may inspect components and systems in addition to those described by the standards of practice

### **GENERAL LIMITATIONS**

**The inspector is not required to:**

**(A) inspect:**

- (i) items other than those listed within these standards of practice;
- (ii) elevators;
- (iii) detached buildings, decks, docks, fences, or waterfront structures or equipment;
- (iv) anything buried, hidden, latent, or concealed;
- (v) sub-surface drainage systems;
- (vi) automated or programmable control systems, automatic shut-off, photoelectric sensors, timers, clocks, metering devices, signal lights, lightning arrestor system, remote controls, security or data distribution systems, solar panels, refrigerators (built-in or free standing), wine coolers, ice makers or smart home automation components; or
- (vii) concrete flatwork such as; driveways, sidewalks, walkways, paving stones or patios

**(B) report:**

- (i) past repairs that appear to be effective and workmanlike except as specifically required by these standards;
- (ii) cosmetic or aesthetic conditions; or
- (iii) wear and tear from ordinary use;

**(C) determine:**

- (i) insurability, warrantability, suitability, adequacy, compatibility, capacity, reliability, marketability, operating costs, recalls, counterfeit products, product lawsuits, life expectancy, age, energy efficiency, vapor barriers, thermostatic performance, compliance with any code, listing, testing or protocol authority, utility sources, or manufacturer or regulatory requirements except as specifically required by these standards;
- (ii) the presence or absence of pests, termites, or other wood-destroying insects or organisms;
- (iii) the presence, absence, or risk of asbestos, lead-based paint, **MOLD**, mildew, corrosive or contaminated drywall "Chinese Drywall" or any other environmental hazard, environmental pathogen, carcinogen, toxin, mycotoxin, pollutant, fungal presence or activity, or poison;
- (iv) types of wood or preservative treatment and fastener compatibility; or
- (v) the cause of source of a condition(s);

**(D) anticipate future events or conditions, including but not limited to:**

- (i) decay, deterioration, or damage that may occur after the inspection;
- (ii) deficiencies from abuse, misuse or lack of use;
- (iii) changes in performance of any component or system due to changes in use or occupancy;
- (iv) the consequences of the inspection or its effects on current or future buyers and sellers;
- (v) common household accidents, personal injury, or death;
- (vi) the presence of water penetrations; or

## 2002 Home with swimming pool

- (vii) future performance of any item;
- (E) operate shut-off, safety, stop, pressure or pressure-regulating valves or items requiring the use of codes, keys, combinations, or similar devices;
- (F) designate conditions as safe;
- (G) recommend or provide engineering, architectural, appraisal, mitigation, physical surveying, realty, or other specialist services;
- (H) review historical records, installation instructions, repair plans, cost estimates, disclosure documents, or other reports;
- (I) verify sizing, efficiency, or adequacy of the ground surface drainage system;
- (J) verify sizing, efficiency, or adequacy of the gutter and downspout system;
- (K) operate recirculation or sump pumps
- (L) remedy conditions preventing inspection of any item;
- (M) apply open flame or light a pilot to operate any appliance
- (N) turn on decommissioned equipment, systems, or utility services; or
- (O) provide repair cost estimates, recommendations, or re-inspection services

**THE CLIENT, BY ACCEPTING THIS PROPERTY INSPECTION REPORT OR RELYING UPON IT IN ANY WAY, EXPRESSLY AGREES TO THE SCOPE OF INSPECTION AND GENERAL LIMITATIONS INCLUDED IN THIS INSPECTION REPORT**

This inspection report is made for the sole purpose of assisting the purchaser to determine his and/or her own opinion of feasibility of purchasing the inspected property and does not warrant or guarantee all defects to be found. If you have any questions or are unclear regarding or findings, please call our office prior to the expiration of any time limitations such as option periods.

This report contains technical information. If you were not present during this inspection, please call the office to arrange for a consultation with your inspector. If you choose not to consult with the inspector, this inspection company cannot be held liable for your understanding or misunderstanding of the reports content.

The contents of this report are for the sole use of the client named above and no other person or party may rely on this report for any reason or purpose whatsoever without the prior written consent of the inspector who authored the report. Any person or party who chooses to rely on this report for any reason or purpose whatsoever without the express written consent of the inspector does so at their own risk and by doing so without the prior written consent of the inspector waives any claim of error or deficiency in this report.

This report is not intended to be used for determining insurability or warrantability of the structure and may not conform to the Texas Department of Insurance guidelines for property insurability. *This report is not to be used by or for any property and/or home warranty company.*

The digital pictures within this report are a representative sample of inaccessible areas, deficiencies, or damages in place and should not be considered to show all of the inaccessible areas, deficiencies or damages observed. There will be inaccessible areas, deficiencies, or damages not represented with digital imaging.

---

I=Inspected NI=Not Inspected NP=Not Present D=Deficiency

I NI NP D

**I. STRUCTURAL SYSTEMS**☒ ☐ ☐ ☐**A. Foundations**

Type of Foundation(s)

☒ Post-Tension ☐ Slab on Grade ☐ Pier and Beam ☐ Bois d'arc☒ At the time of the inspection the foundation appeared to be performing its function

**Notice:** This inspection is one of first impression and the inspector was not provided with any historical information pertaining to the structural integrity of the inspected real property. This is a limited cursory and visual survey of the accessible general conditions and circumstances present at the time of this inspection. Opinions are based on general observations made without the use of specialized tools or procedures. (*Unless otherwise noted*) Therefore, the opinions expressed are one of apparent conditions and not of absolute fact and are only good for the date and time of this inspection.

The inspection of the foundation may show it to be providing adequate support for the structure or having movement typical to this region at the time of the inspection. This does not guarantee the future life or failure of the foundation.

**The Inspector is not a structural engineer. This inspection is not an engineering report or evaluation and should not be considered one, either expressed or implied.** If any cause of concern is noted on this report, or if you want further evaluation, you should consider an evaluation by an engineer of your choice.

☒ ☐ ☐ ☒**B. Grading and Drainage**☒ Improper or inadequate grading around the foundation☒ Soil level should be at least 4" below brick/stone siding☒ Water can be trapped between landscaping and foundation, monitor area for proper drainage☒ Deficiencies in installed gutter and downspout systems☒ Damaged extension observed:



I=Inspected NI=Not Inspected NP=Not Present D=Deficiency

I	NI	NP	D
---	----	----	---

☒ ☐ ☐ ☒

### C. Roof Covering Materials

Type of Roof Covering: ☒ Composition ☐ Metal ☐ Tile

Viewed From: ☒ Roof ☐ Ladder ☐ Ground with binocular

Roof Condition: ☐ New ☒ Good ☐ Average ☐ Aged

☒ Roof covering materials

☒ Torn or missing shingles observed



☒ Surface (mechanical) damage observed





I=Inspected NI=Not Inspected NP=Not Present D=Deficiency

I	NI	NP	D
---	----	----	---


☒ Evidence of impact damage observed to the “soft” metals. Roof vents, turbines, etc.



☒ Rubber boot(s) are “cupped” and will hold water. Repair/replace as necessary for proper drainage



☒ There are nail heads or staples exposed (missing sealant) on some of the flashing, roof vents and in the cap shingles. Recommend sealing to prevent water penetration

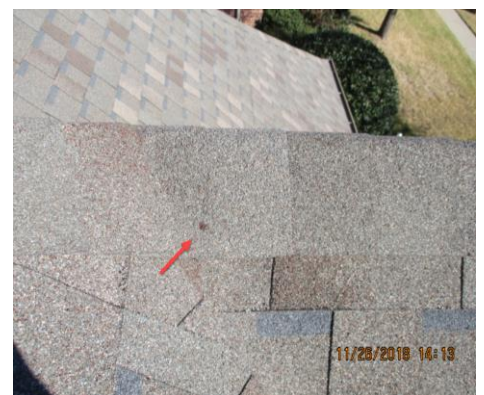

I=Inspected NI=Not Inspected NP=Not Present D=Deficiency

I NI NP D

**Notice:** Life expectancy of the roofing material is not covered by this property inspection report. If any concerns exist about the roof covering life expectancy or potential for future problems, a roofing specialist should be consulted. The Inspector cannot offer an opinion or warranty as to whether the roof has leaked in the past, leaks now, or may be subject to future leaks, either expressed or implied. The inspection of this roof may show it to be function as intended or in need of minor repairs. This inspection does not determine the insurability of the roof. You are strongly encouraged to have your Insurance Company physically inspect the roof, prior the expiration of any time limitations such as option or warranty periods, to fully evaluate the insurability of the roof.

☒ ☐ ☐ ☒

**D. Roof Structures & Attics**

Attic viewed from: ☒ Attic ☐ Attic access opening ☐ No access

☒ Not all areas of the attic accessible due to structure, ducting, storage items, and/or insulation


☒ Attic access door missing insulation – Based on the age of the home, I do not expect to see this feature, but it can help with energy efficiency

☒ Loose nuts and bolts and/or loose/missing hardware on attic stairs

☒ Missing nails at metal mounting brackets



☒ Missing shims at attic stairs

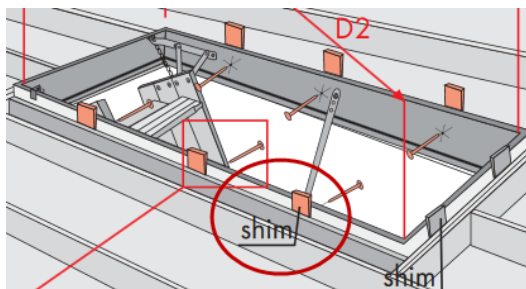

I=Inspected NI=Not Inspected NP=Not Present D=Deficiency

I	NI	NP	D
---	----	----	---

Approximate Average Depth of Insulation:

☐ 4-6 inches ☐ 8-10 inches ☐ 10-12 inches ☒ 13-15 inches ☐ 20+

**Note:** Generally recommended depth of attic floor insulation is approximately 10+ inches to achieve an R 30 rating)

Attic Ventilation

☒ Soffit vents

☒ Exhaust ports

☒ ☐ ☐ ☒


### E. Walls (Interior and Exterior)

**Notice:** If home is occupied, I am unable to inspect all of the interior surfaces because of window treatments, personalized wall treatments / finishes, personal effects, large, heavy or fragile, storage and /or furniture and rugs

☒ Visible cracks in brick observed



☒ Re-Point (Repair/patch) missing or cracked mortar

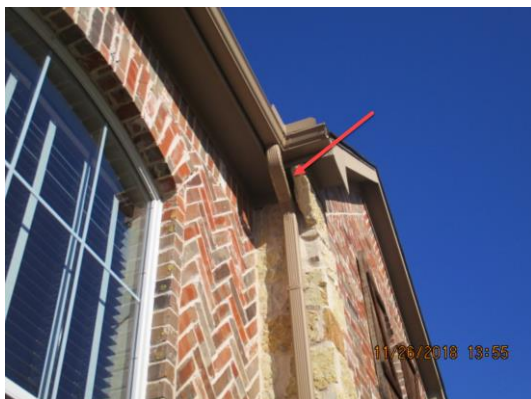



I=Inspected NI=Not Inspected NP=Not Present D=Deficiency

I	NI	NP	D
---	----	----	---

☒ Deficiencies in:

☒ Claddings

☒ Cracked/damaged/loose siding observed. Replace/repair as necessary



☒ Flashing details and terminations

☒ Missing caulking observed:





I=Inspected NI=Not Inspected NP=Not Present D=Deficiency

I	NI	NP	D
---	----	----	---

☒ ☐ ☐ ☒

## F. Ceilings and Floors

☒ Deficiencies in ceiling

☒ Visible cracks observed

☒ ☐ ☐ ☒

## G. Doors (Interior and Exterior)

☒ Deficiencies in the condition and operation of interior doors

☒ Door swings open/closed on its own – Jack/Jill and utility room

☒ Doors do not latch when closed – Jack/Jill and master bedroom

☒ Missing, damaged, ineffective door stops observed – Several locations

☒ Deficiencies in the condition and operation of door locks and latches

☒ Door hinges missing screws – Entry and office exterior door

☒ Loose door knobs observed – Several locations

☒ Dead bolts do not engage the door frame smoothly – Entry

☒ Ball latch on French doors missing or do not latch. Replace or adjust as necessary – Master bathroom

☒ Deficiencies in the condition and operation of garage overhead door

☒ Damaged or missing weather stripping



I=Inspected NI=Not Inspected NP=Not Present D=Deficiency

I	NI	NP	D
---	----	----	---

☒ ☐ ☐ ☒

## H. Windows

Note: 2<sup>nd</sup> story windows over the 1<sup>st</sup> floor not accessible

Note: Not all windows accessible, blocked by furniture and/or storage

Note: Windows with solar screens or dirty windows are difficult to evaluate.


☒ Insulated windows fogged or displaying other evidence of broken seals or altered tinting observed. Windows with solar screens or dirty windows are difficult to evaluate. At least 15 windows and 0 doors have lost their seal. The windows and/or doors have been marked with an "X". I recommend further evaluation by a window or glass company.

☒ Deficiencies in:

☒ Chipped/peeling paint observed on window sill – Dining room



☒ 2<sup>nd</sup> story windows within 24" of the floor should be fixed (not openable) or have openings through which a 4 – inch diameter sphere cannot pass

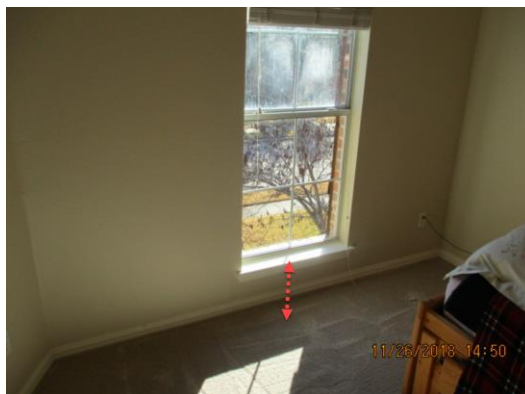

I=Inspected NI=Not Inspected NP=Not Present D=Deficiency

I	NI	NP	D
---	----	----	---

☒ Glazing compound in windows and doors



☒ Caulking weathered and cracked at windows around the house, re-caulk missing and weathered caulking to prevent water penetration


☒ Damaged and missing window screens observed

☒ ☐ ☐ ☒

## I. Stairways (Interior and Exterior)

☒ Deficiencies in:

☒ Stairways - Loose spindles observed

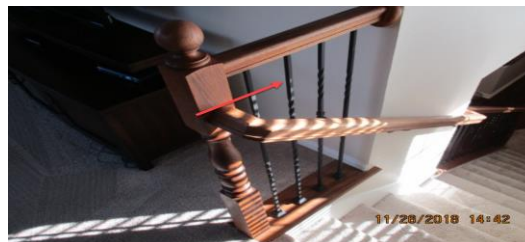

☒ Handrail is loose



I=Inspected NI=Not Inspected NP=Not Present D=Deficiency

I	NI	NP	D
---	----	----	---

☒ ☐ ☐ ☒

## J. Fireplaces and Chimneys

Type of Fireplace:


☒ Metal Insert ☐ Masonry ☐ Wood stove ☐ Vent-free gas logs

Type of chimney: ☒ Metal ☐ Tile ☐ Brick

Vantage point: ☒ Roof ☐ Ground w/ binoculars ☐ Roof edge



☒ The presence of combustible materials in near proximity of the firebox opening – Top

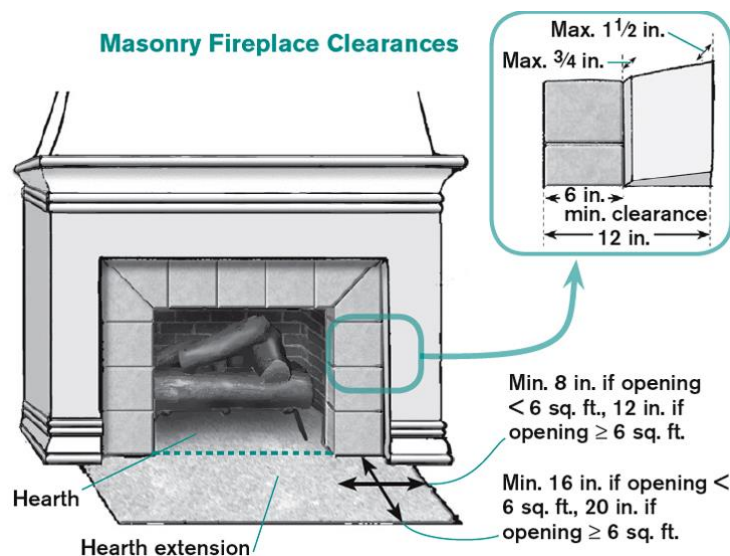



I=Inspected NI=Not Inspected NP=Not Present D=Deficiency

I	NI	NP	D
---	----	----	---

☒ Clearances from combustible materials

☒ Need minimum 1 ½ "clearance from vent pipe to combustible materials



☒ ☐ ☐ ☐

## K. Porches, Balconies, Decks, and Carports

**Notice:** Structural load capabilities of porches, decks, and balconies was not inspected

## II. ELECTRICAL SYSTEMS

☒ ☐ ☐ ☒

### A. Service Entrance and Panels

Main disconnect rating Amps ☒ 200 ☐ 150 ☐ 125 ☐ 100 ☐ Unknown

Electrical panel location ☒ Garage ☐ Closet ☐ Outside

Service entrance wire type: ☒ Copper ☐ Aluminum ☐ Unknown

☒ Neutral bar should be removed in sub panel



Note: Electrical supply to the washer dryer is not inspected in a TREC inspection.

Note: Arc-fault circuit interrupter devices not tested when home is occupied. Arc-fault circuit interrupters are now required in all habitable rooms of the home by today's standard

I=Inspected NI=Not Inspected NP=Not Present D=Deficiency

I	NI	NP	D
---	----	----	---

☒ ☐ ☐ ☒

## B. Branch Circuits, Connected Devices and Fixtures

Type of wiring: ☒ Copper ☐ Aluminum ☐ Unknown


Branch circuit wiring: ☒ Grounded 3 wire ☐ Ungrounded 2 wire

☒ Deficiencies in:

☒ Receptacles

☒ Not secured in place, loose on the wall – receptacle marked with letter “L” to identify

☒ Bonding or grounding - Appliances such as water heaters, furnaces, chimneys and electrical gutters do not have proper bonding - See page 2

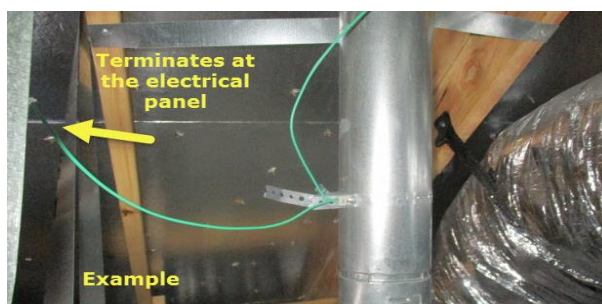

☒ Lack of service receptacle at A/C condensing unit

☒ Exposed receptacles are not equipped with water tight “when in use” type enclosures – Based on the age of the home, I do not expect to see this type of enclosure. Today’s standards would require this type of enclosure to be present on all exposed receptacles.



“Old Style”



“New Style”

I=Inspected NI=Not Inspected NP=Not Present D=Deficiency

I	NI	NP	D
---	----	----	---

☒ Deficiencies in lighting devices

☒ Several bulbs on fixtures did not engage, replace bulbs and retry

☒ Fixture not secure to ceiling/wall



☒ Deficiencies in ceiling fans

☒ Fan(s) out of balance – Game room

Note: Lights and equipment activated by photocell switches were not checked. Landscape and/or exterior low-voltage ground lighting is not included in this inspection.

Note: Smoke detectors are not checked when a security system is in place.

Note: Electrical outlets are randomly sampled during inspection and should you have any concerns over the wiring you should consult with a licensed electrician.

I=Inspected NI=Not Inspected NP=Not Present D=Deficiency

I NI NP D

### III. HEATING, VENTILATION AND AIR CONDITIONING SYSTEMS

☒ ☐ ☐ ☒


#### A. Heating Equipment

Type of System ☒ Forced Air ☐ Heat pumpNumber of units: ☐ 1 ☒ 2 ☐ 3 ☐ 4Energy Source: ☐ Electric ☒ Natural gas ☐ PropaneIn gas units branch line is: ☒ Iron/Flex ☐ Copper☒ The vent pipe, draft hood, draft, proximity to combustibles, and vent termination point and clearances☒ Need 1" clearance from vent pipe to combustible materials – Downstairs unit
☒ ☒ ☐ ☐

#### B. Cooling Equipment (other than evaporative coolers)

Note: The new Freon standards were implemented as part of the Clean Air Act, which is enforced by the U.S. Environmental Protection Agency. By the year 2020, R22 Freon will no longer be manufactured

Type of System: Central air conditioner

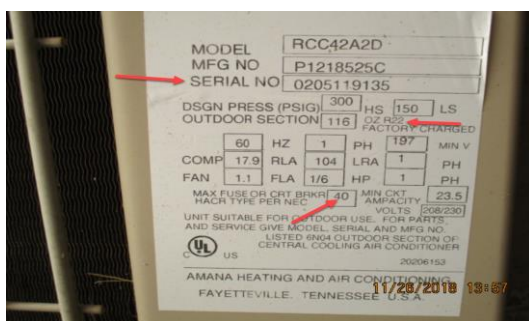Number of units: ☐ 1 ☒ 2 ☐ 3 ☐ 4




I=Inspected NI=Not Inspected NP=Not Present D=Deficiency

I	NI	NP	D
---	----	----	---

☒ Cooling equipment not tested for cooling, outdoor temperature below 60° in last 24 hours. The condenser(s) were operated briefly to ensure the unit(s) do engage with the thermostat. This does not guarantee the system is cooling and operating properly. If a more complete inspection of the cooling equipment is desired, I recommend have the system evaluated by an HVAC technician

**Notice:** Temperature differential readings are an accepted industry standard of practice for testing the proper operation of the cooling system. Normal acceptable range is considered approximately **between 15 to 20 degrees °F** total difference (Delta-T) measured between the return air and supply air within close proximity of the related coils of the system being evaluated. Conditions such as but not limited to; excessive humidity, high or low outdoor temperatures or restricted airflow may indicate abnormal operation even though the equipment is functioning basically as designed and occasionally may indicate normal operation in spite of an equipment malfunction. The inspector will not be able to anticipate future events, conditions or changes in performance of any component or system due to changes in use or occupancy. **The inspector makes no guarantee or warranty, express or implied, as to the future performance of any item, system or component**

☒ Primary drain line not insulated. Insulating the drain line prevents condensation dripping in attic- Both

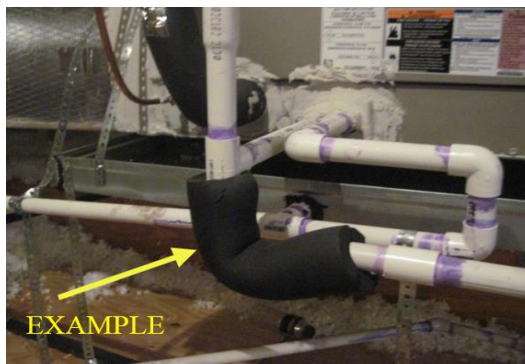

☒ Deficiencies in primary and/or secondary drain pipe

☒ Primary drain pipe termination not visible/located

I=Inspected NI=Not Inspected NP=Not Present D=Deficiency

I	NI	NP	D
---	----	----	---

☒ ☐ ☐ ☒

### C. Duct System, Chases and Vents

- ☒ Missing or cracked tape/mastic observed at the air handler.  
Recommend resealing mastic/tape to prevent heat/air from blowing out –  
Both units



- ☒ Filter door does not close completely – this allows unconditioned attic air to enter the unit – Both



I=Inspected NI=Not Inspected NP=Not Present D=Deficiency

I	NI	NP	D
---	----	----	---

#### IV. PLUMBING SYSTEMS

☒ ☐ ☐ ☒

##### A. Plumbing Supply, Distribution Systems and Fixtures

Note: All interior plumbing fixtures are operated for 2-5 minutes during inspection

Location of water meter: ☒ Front curb ☐ Rear alley

Location of homeowner's main water supply shutoff valve:

☐ Not located ☒ Flower bed ☐ Garage ☒ Valve handle not visible

☐ Front yard ☐ Laundry room

Static water pressure is: 70 psi

Normal pressure: 40-80 psi

Type of Supply Lines:

☒ Copper ☐ Pex ☐ Galvanized Iron ☐ PVC/CPVC

☒ Hose bibs

☒ Not able to attach testing device to right elevation hose bib

☒ Leaking anti-siphon device while in use – Right elevation



☒ The condition of the gas distribution system

☒ Gas line should be painted to help prevent rust – All exterior locations

☒ Functional drainage at fixtures – Recommend further evaluation by licensed plumber

I=Inspected NI=Not Inspected NP=Not Present D=Deficiency

I	NI	NP	D
---	----	----	---

☒ Slow to drain at: Right master lavatory

☒ Installation, condition, and operation of commodes

☒ Possible water leak at half bath commode observed:




☒ Fixtures, showers, tubs, and enclosures

☒ Shower door does not close properly – Master

☒ Shower diverter not fully engaged – Both tubs

☒ Cracks in surface of sink-tub basin – Right master lavatory

☒ Hand sprayer hose should not be long enough to hang below the edge of tub. Not able to verify if anti-siphon device present

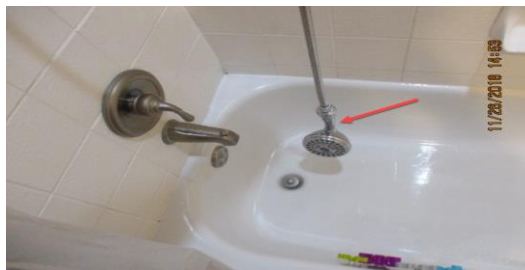

☒ Fixtures not securely mounted at: Hot/cold at master tub

☒ Missing caulk/grout at tubs and showers. Recommend re-caulking and/or /replacing grout to prevent water penetration

☒ All tubs/shower



I=Inspected NI=Not Inspected NP=Not Present D=Deficiency

I NI NP D

**Notice:** The Inspector has attempted to discover and report conditions requiring further evaluation or repair. However; determining the condition of any component that is not visible and /or accessible, such as plumbing components that are buried, beneath the foundation, located within construction voids or otherwise concealed, and reporting any efficiency that does not appear or become evident during our limited cursory and visual survey is outside the scope of this inspection. **The inspector makes no guarantee or warranty, express or implied, as to the future performance of any item, system or component**


☒ ☐ ☐ ☐
**B. Drains, Wastes, and Vents**

Type of waste lines:

☒ PVC ☐ Iron ☐ Tile

This inspection does not include a clothes washer drain inspection

**Notice:** Reporting the condition of drains, wastes and vent piping that is not completely visible and/or accessible or; reporting any defect or deficiency that requires extended use of the system to develop or does not become evident during our limited cursory and visual survey is outside the scope of the inspection. This is a limited cursory and visual survey of the accessible general observations made without the use of specialized tools or procedures. Therefore, the opinions expressed are one of apparent conditions and not of absolute fact and only good for the date and time of this inspection. **The inspector will not be able to anticipate future events, conditions or changes in performance of any component or system due to changes in use or occupancy. The inspector makes no guarantee or warranty, express or implied, as to future performance of any item or component**

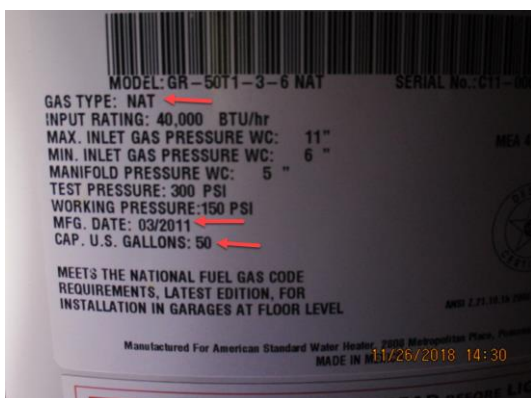☒ ☐ ☐ ☒
**C. Water Heating Equipment**Energy Source: ☒ Natural gas ☐ Electric ☐ PropaneNumber of units: ☐ 1 ☒ 2 ☐ 3
☐ 29 gal ☐ 40 gal ☒ 50 gal ☐ 74.9 gal ☐ Tankless
☐ Unknown, wrapped with insulation

I=Inspected NI=Not Inspected NP=Not Present D=Deficiency

I	NI	NP	D
---	----	----	---

☒ I recommend further evaluation by a licensed plumber

☒ The flexible appliance connector is required to be yellow or silver color by today's standard. Older style appliance connectors can contain a copper liner which can corrode and leak with natural gas



Branch Line:

☒ Iron/Flex ☐ Copper

Type of Observable Vent Pipe:

☒ Double Wall

☒ Dent observed: Right unit



☒ A temperature and pressure relief valve that:

☒ Valve not forced open at time of inspection. Forcing valve open can cause valve to leak after testing because of sediment and corrosion build up in tank.

☐ ☐ ☒ ☐

## D. Hydro-Massage Therapy Equipment

I=Inspected NI=Not Inspected NP=Not Present D=Deficiency

I	NI	NP	D
---	----	----	---

## V. APPLIANCES

☒ ☐ ☐ ☒

### A. Dishwasher

☒ Deficiencies in performance or mounting

☒ Unit is not securely mounted

☒ ☐ ☐ ☐

### B. Food Waste Disposers

☒ ☐ ☐ ☒

### C. Range Hood and Exhaust Systems

☒ I recommend further evaluation by an appliance technician

☒ Deficiencies in performance

☒ Control knob broken – hood did not operate during inspection

☒ ☐ ☐ ☒

### D. Ranges, Cooktops, and Ovens

Type of Range or Cooktop ☐ Electric ☒ Gas

Type of Oven(s): ☒ Electric ☐ Gas

Branch Line: ☒ Iron/Flex ☐ Copper

☒ I recommend further evaluation by an appliance technician

Gas shut off valve

☒ Present and Accessible within 6 feet of appliance

☒ Shut-valve should be hand operated, not requiring tools

Temperature when set at 350°

Upper oven - 357

Lower oven - 340

Temperature is within 0 +/- 25° ☒ Yes ☐ No

☒ Labeling is worn at buttons and knobs

☒ Signal lights, elements or burners do not operate at high settings –  
Rear right had low flame

I=Inspected NI=Not Inspected NP=Not Present D=Deficiency

I	NI	NP	D
---	----	----	---

<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
-------------------------------------	--------------------------	--------------------------	--------------------------

**E. Microwave Oven**

<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>
-------------------------------------	--------------------------	--------------------------	-------------------------------------

**F. Mechanical Exhaust Vents and Bathroom Heaters**

- ☒ Vent pipes that do not terminate outside the structure – Based on the age of the house, I do not expect to see ventilation to the outside. Today's standards require all exhaust vents to terminate outside


<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>
-------------------------------------	--------------------------	--------------------------	-------------------------------------

**G. Garage Door Operator(s)**

- ☒ Deficiencies in performance or mounting
- ☒ Door does not automatically reverse during closing cycle when pressure applied – adjust closing pressure at back of the operator



- ☒ Door locks or side ropes have not been removed or disabled. A door lock is not required when an opener is present

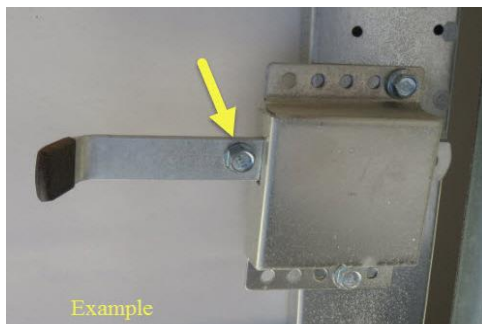

<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
-------------------------------------	--------------------------	--------------------------	--------------------------

**H. Dryer Exhaust Systems**



I=Inspected NI=Not Inspected NP=Not Present D=Deficiency

I	NI	NP	D
---	----	----	---

## VI. OPTIONAL SYSTEMS

☒ ☐ ☐ ☒

### A. Landscape Irrigation (Sprinkler) Systems

Number of Zones: 7

☒ System equipped with a moisture (rain/freeze) sensor ☐ Yes ☒ No/not located

Note: Some municipalities now require moisture (rain/freeze) sensors to be installed on all new installation and existing sprinkler systems. Our company does not maintain list of municipalities that require the installation of a moisture sensor. Please check with your municipality for moisture sensor requirements.

☒ Deficiencies in the performance and mounting of the controller. Loose

☒ Drip line should be buried to prevent damage



☒ Sprinkler systems are no longer permitted to be connected to swimming pools. This type of connection can allow pool water to enter the fresh water system – Zone 9

Note: The inspector does not inspect for effective coverage, the automatic function of the controller, the effectiveness of the sensors such as rain, moisture, wind, flow or freeze sensors, or sizing and effectiveness of backflow prevention device.

I=Inspected NI=Not Inspected NP=Not Present D=Deficiency

I	NI	NP	D
---	----	----	---

☒ ☐ ☐ ☒

**B. Swimming Pools, Spas, Hot Tubs, and Equipment**

Type of construction:

☒ Gunite ☐ Fiberglass ☐ Vinyl



☒ I recommend further evaluation by a licensed pool technician

Type of Heater: ☒ Gas ☐ Electric ☐ Propane ☐ Heat Pump ☐ None

Gas Shut Off Valve:

☒ Present and accessible ☐ Not Present/and or Observable

**Notice:** When the system is operational, all of the pool or spa systems and associated components are inspected and operated in the Manual / service settings only. Operating the pool components from indoor control panels, spa/pool side controllers or handheld remotes are outside the scope of this inspection

I=Inspected NI=Not Inspected NP=Not Present D=Deficiency

I	NI	NP	D
---	----	----	---

Branch Line:

☒ Iron/Flex ☐ Copper

☒ Shut-valve should be hand operated, not requiring tools



☒ Deficiencies in:

☒ Pool heater did not operate during inspection. Have seller demonstrate function or have further evaluation by a licensed pool technician

☒ Water leaks in above-ground pipes and equipment



☒ Above-ground pipes should be painted to prevent UV damage. UV light can cause damage and crack the above ground pipes

I=Inspected NI=Not Inspected NP=Not Present D=Deficiency

I	NI	NP	D
---	----	----	---



☒ Service disconnect for pool/spa light not visible

☒ Missing cap



☒ Tiles, coping, and decks

☒ Pool surface stained and has worn appearance

☒ Missing/deteriorated mastic observed. Mastic should be resealed to prevent water penetration



☒ Repoint cracked/missing mortar at coping and/or tile to prevent water penetration



I=Inspected NI=Not Inspected NP=Not Present D=Deficiency


I	NI	NP	D
---	----	----	---



☒ All metal components within 5' of the pools edge should be bonded. The lack of bonding is a safety hazard.

Not able to verify bonding of the:

☐ Diving board ☒ Fence ☐ Handrails ☐ Window frames/screens

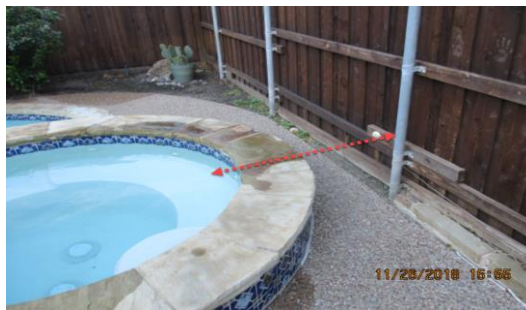

☒ Drains, skimmers, and valves

☒ Damaged drain cover observed:



☒ Debris observed at skimmers

☒ Filters, gauges, pumps, motors, controls, and sweeps

I=Inspected NI=Not Inspected NP=Not Present D=Deficiency

I	NI	NP	D
---	----	----	---

☒ Handle missing



☒ Missing nuts at valve handles – replace as necessary



Normal pressure is 15-25 for a D.E. filter (Diatomaceous Earth)

☒ Pressure was observed to be: 28



☒ Pool equipment not labeled

☒ Door alarms not present

All doors leading into the pool area must be equipped with an alarm. The alarm sounds continuously for at least thirty (30) seconds or until the alarm is manually reset (if the door closes within the 30 second period, the alarm is manually reset). The alarm is capable of being heard throughout the house during normal household activities. The alarm should automatically reset under all conditions

**I=Inspected NI=Not Inspected NP=Not Present D=Deficiency****I NI NP D**

**Notice:** Based on what we were able to observe and our experience with swimming pool, spa and hot tub technology, we submit this inspection report based on the present condition, working under current use and habits of the current occupants of the residence. When performing the inspection, the inspector will keep in consideration the age of the system and normal wear and tear from ordinary use when rendering opinions. All of the pool or spa systems and associated components are inspected and operated in the manual / service settings only. Operating the pool components from indoor control panels, spa/pool side controllers or handheld remotes are outside the scope of this inspection.

For further assistance and inspections, we recommend contacting a licensed pool contractor or ask the Seller if you may discuss the pool or spa with the maintenance company that the Seller is or has used to clean and service the pool or spa.

The Inspector shall inspect and report deficiencies in the condition of all associated above ground and accessible components. This inspection does not include evaluations of freeze guard controls and /or devices or pool, spa or hot tub bodies / shells below the water line and does not insure, guarantee or warrant against structure or sub-surfaces water leaks, either expressed or implied.

**The inspector will not be able to anticipate future events, conditions or changes in performance of any component or system due to changes in use or occupancy. The inspector makes no guarantee or warranty, express or implied, as to future performance of any item, system or component.**

#### **Specific limitations for swimming pools, spas, hot tubs, and equipment.**

The inspector is not required to and will not:

- disassemble filters or dismantle or otherwise any components or lines;
- operate valves;
- uncover or excavate any lines or concealed components of the system;
- fill the pool, spa, or hot tub with water;
- inspect any system that has been winterized, shut down, or otherwise secured;
- determine the presence of sub-surface water tables;
- determine the effectiveness of entrapment covers;
- determine the presence of pool shell or sub-surfaces leaks; or
- inspect ancillary equipment such as computer controls, covers, chlorinators or other chemical dispensers, or water ionization devices or conditioners other than required by this section.

☐ ☐ ☒ ☐

#### **C. Outbuildings**

☐ ☐ ☒ ☐

#### **D. Private Water Wells (A coliform analysis is recommended)**

☐ ☐ ☒ ☐

#### **E. Private Sewage Disposal (Septic) System**

☐ ☐ ☒ ☐

#### **F. Other**

**I=Inspected NI=Not Inspected NP=Not Present D=Deficiency**

<b>I</b>	<b>NI</b>	<b>NP</b>	<b>D</b>
----------	-----------	-----------	----------

### IMPORTANT LIMITATIONS AND DISCLAIMERS

This Inspection Report reports only on the items listed and only on the condition of those items at the time of inspection. This Inspection Report reflects only if the items inspected are observed to be "operable" or "inoperable" at the time of inspection. Operable means that the item is observed to serve the purpose for which it is ordinarily intended. This Report reflects only those items that are reasonably observed at the time of inspection. No representation or comment is made concerning any later defect or defects not reasonably observable at the time of the inspection or of items, which require the removal of major or permanent coverings. The inspection of swimming pools and spas is limited to the above ground accessible equipment and plumbing. For example, but without limitation, recent repairs, painting or covering may conceal prior or present leak damage, which is not reasonably observable by the inspector and no representation, or comment can be made. No representation is made concerning any other condition or the future performance of any item. No representation is made as to items not specifically commented upon. All warranties, expressed or implied, not specifically stated herein are excluded and disclaimed. If a comment is made concerning the condition of any item, the Buyer is urged to contact a qualified specialist to make further inspections or evaluations of that item. Buyer must notify Elite Inspection Group LLC in writing of any complaints within seven (7) days of inspection and must thereafter allow prompt re-inspection of the item complained of; otherwise, all claims for damages arising out of such complaints are waived by Buyer. If Buyer institutes any legal action concerning this inspection, and fails to prevail on all of the causes of action alleged, Buyer shall be liable to Elite Inspection Group LLC for all legal fees incurred in such action. Actual damages for any breach of contract or warranty, negligence or otherwise are limited to the amount of the inspection fee paid. Buyer, by accepting this Report or relying upon it in any way, expressly agrees to these Limitations and Disclaimers. For more information concerning your rights, contact the Consumer Protection Division of the Attorney General's Office, District, or County Attorney, or your personal attorney of choice. If a dispute arises out of or relative to the independent inspector's performance and, if said dispute cannot be settled between the parties to this inspection by state standards, the parties hereto agree to settle the dispute through binding arbitration according to the Commercial Arbitration Rules of the Arbitration Association, and judgment upon the award rendered by the arbitrator(s) may be entered in any court having jurisdiction thereof. All requests for arbitration shall be submitted to the Dallas Office of the American Arbitration Association and all arbitration administration costs shall be borne equally by all the parties to the dispute. Any event of waiver by this company of any right herein shall not constitute a continuing waiver or subsequent waiver of other rights. This Report constitutes the sole and only agreement of parties hereto and supersedes any prior understanding or written or oral agreements between the parties respecting the subject matter within. I fully and completely understand that this inspection is not a warranty or a guarantee. This inspection is essentially visual, it is not exhaustive, and it does not imply that every defect will be discovered. It is only a statement of operation and/or condition as of and on the date of inspection.

### INSPECTOR

Darrell Murphy – TREC # 22992

PO Box 2205

Frisco, TX 75034

318-218-9518